


- NOTES:**
1. CONNECTION TO NEW SEWER SHALL BE WITH TEE OR WYE.
 2. NO TEES OR WYES ON SEWERS LARGER THAN 18"Ø.
 3. WHERE SERVICE LINE CROSSES STATE HWY RW, PIPE AND FITTINGS SHALL BE MECHANICAL JOINT D.I. PIPE AS SPECIFIED UNDER ITEM NO. 7 D.I. PIPE AND TRENCH SHALL BE BACKFILLED WITH CRUSHED STONE.

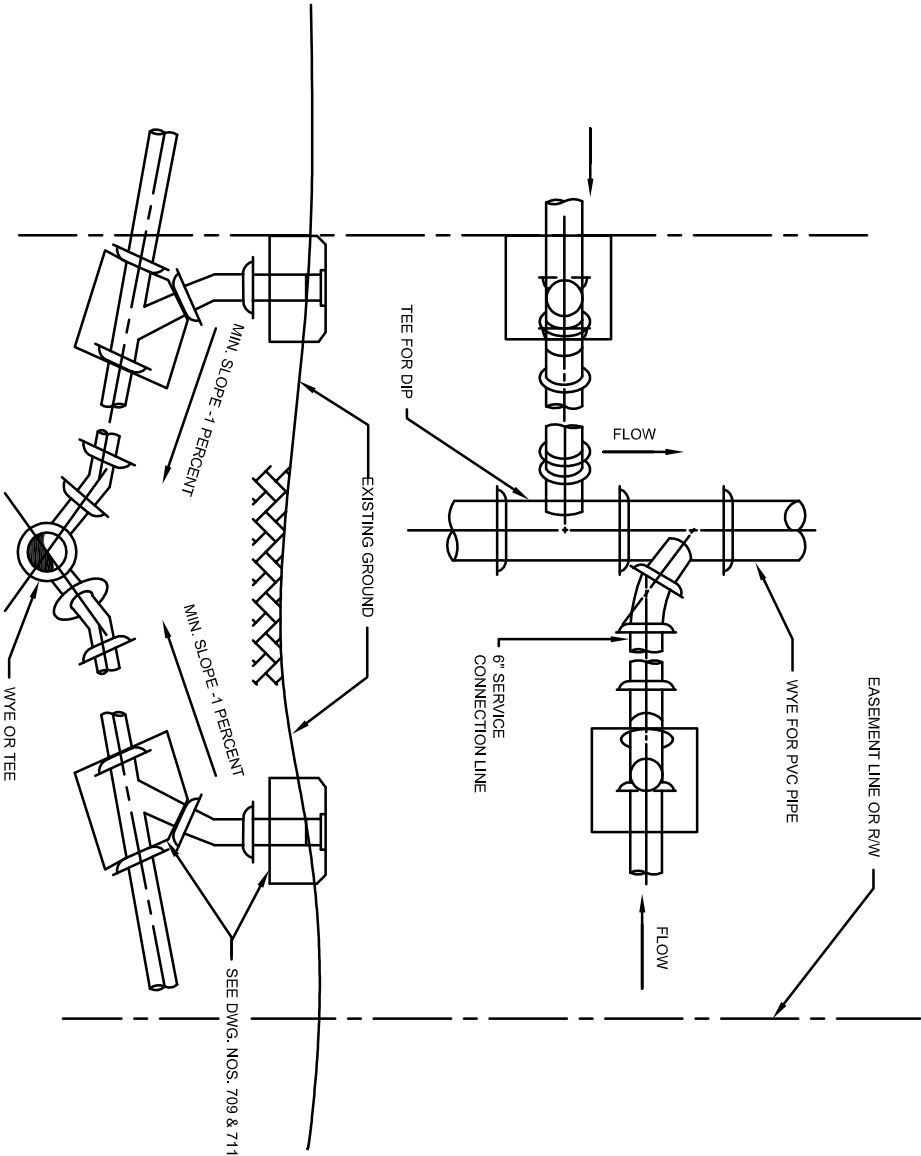

FULTON COUNTY STANDARD DETAIL 707 SERVICE CONNECTION ON NEW SEWERS																					
DATE		REVISIONS				DATE		REVISIONS													
8/08		NRR																			